


REV. NO.	DATE	REVISION COMMENTS	DRAWN BY	CHECKED BY

KEY NOTES

- ①
- RE-ROUTE EXISTING TRANSFORMERS R1, R2 AND R3 FROM EXISTING UPS OUTPUT DISTRIBUTION PANEL TO PANEL P-1 BY UTILIZING AVAILABLE SPARE BREAKERS AND CONDUITS.
- ②
- FINAL TRANSFORMERS TERMINATION SHALL BE DONE DURING MAINTENANCE WINDOW.

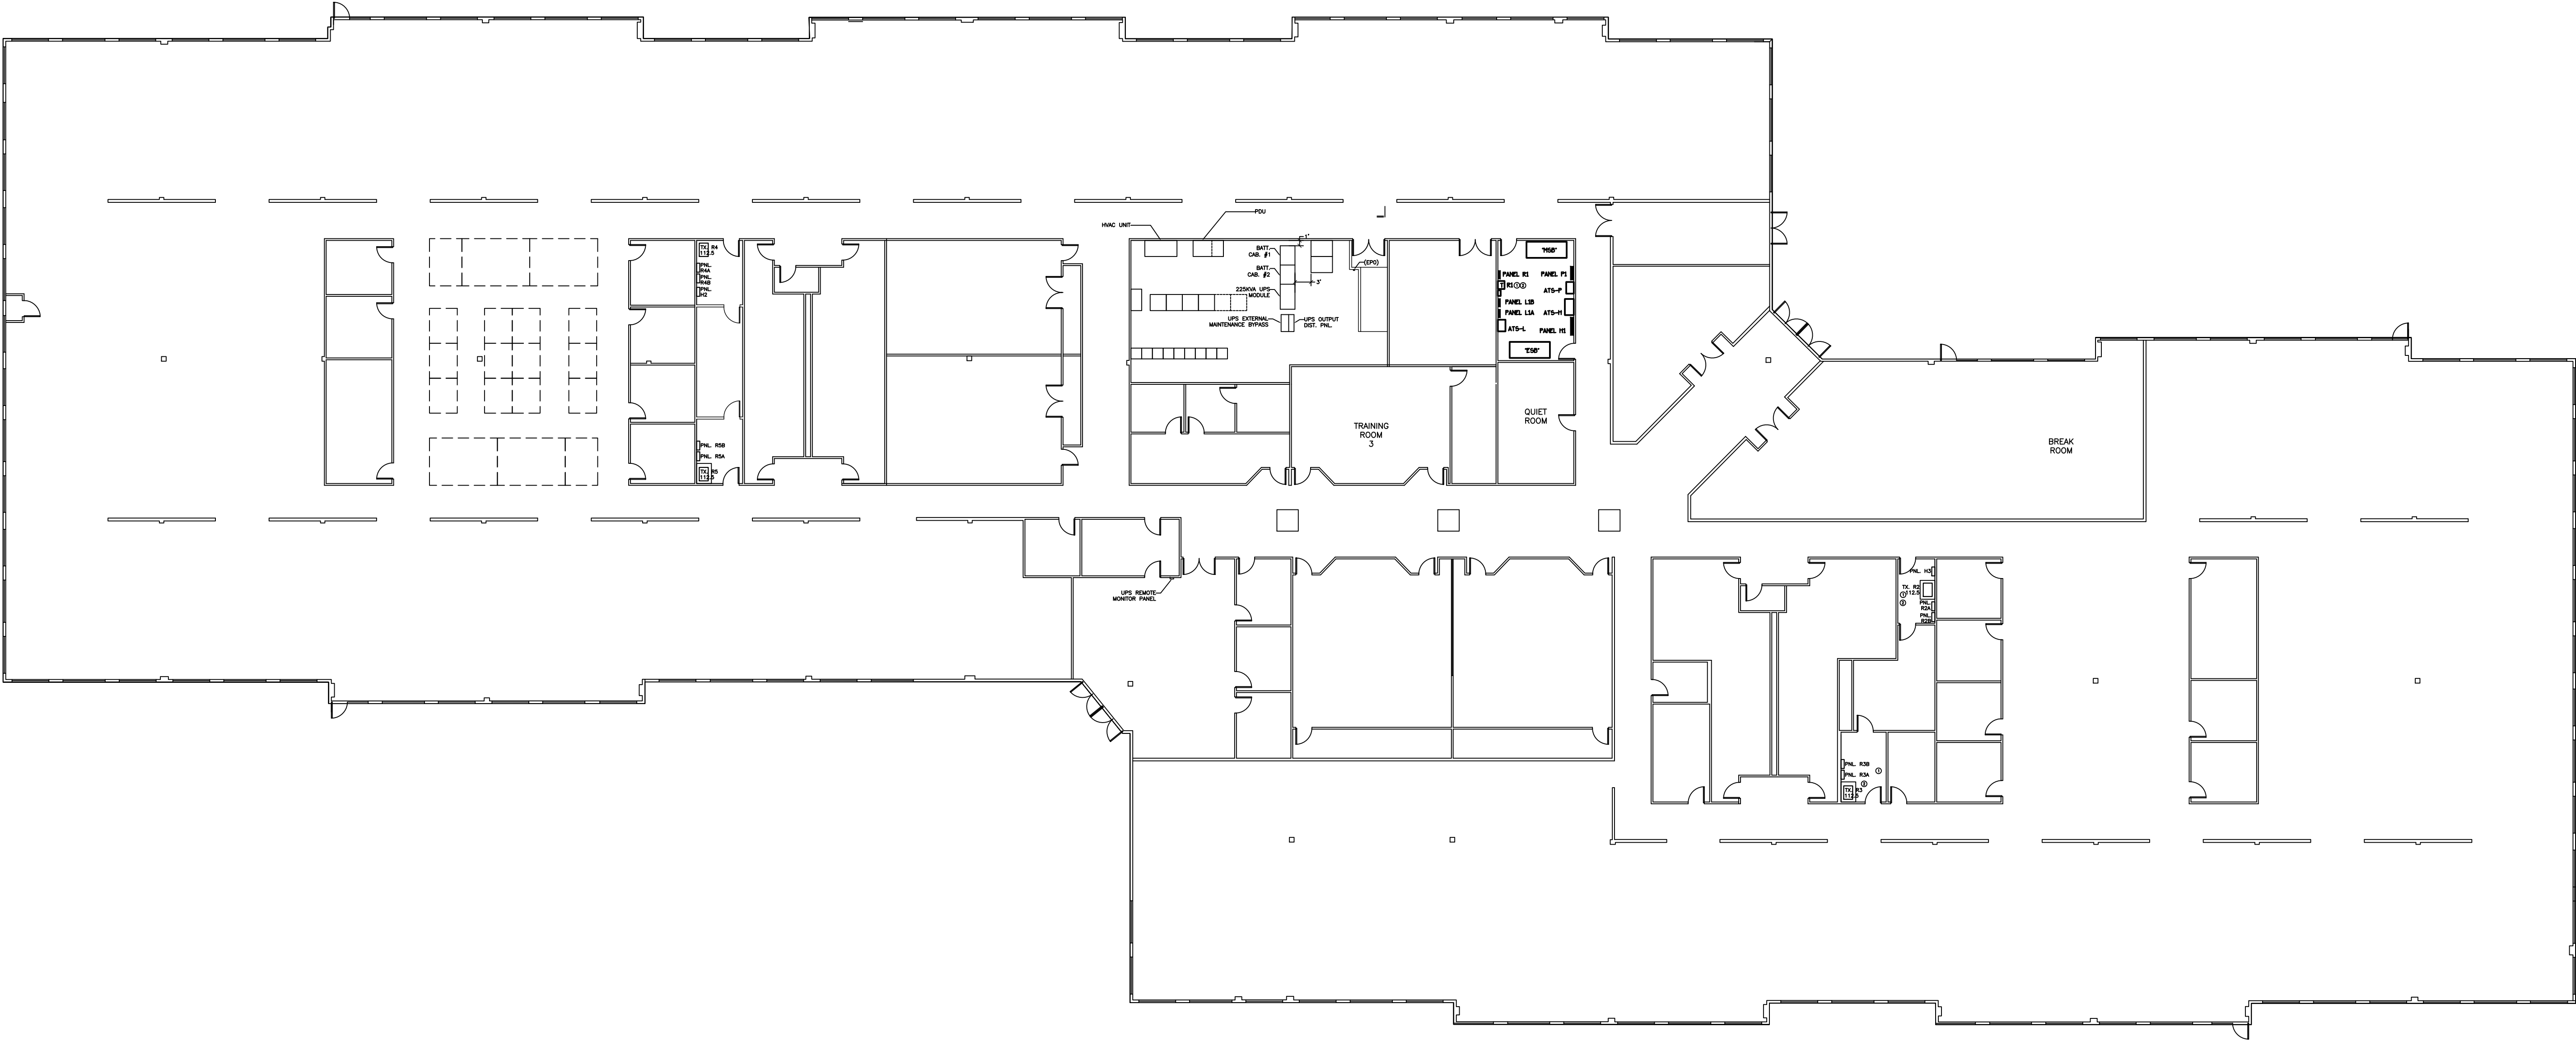

E²MC ELECTRICAL ENGINEERING & MANAGEMENT COMPANY 24831 BUCKSKIN DR. LAGUNA HILLS CA 92653 PH/FAX: (949) 582-5878	DRAWN: A.A.		STAMP
	DATE: 04/23/2013		
	CHECKED: M.B.		
	SCALE: 1/16"=1'		
Sprint LD NETWORK LOGISTICS	UPS POWER REMOVAL FROM GIVE BACK SPACE 200 RICHARD JACKSON BLVD. PANAMA CITY BEACH, FL 32407-2511		Sheet 3
	STD CODE FLPCBC	BLDG ID	EQUIPMENT ROOM LAYOUT FLPCBCE03.DWG